

Phosphorus and pathogen removal from wastewater, storm water and groundwater using permeable reactive materials

Smyth, D.J.A.¹, Blowes, D.W.¹, Płacek, C.J.^{2,1}, Groza, L.E.¹, Baker, M.J.³ and Crawford, W.⁴

¹Department of Earth Sciences, University of Waterloo, Waterloo, ON
²National Water Research Institute, Environment Canada, Burlington, ON
³Shell Canada Limited, Calgary, AB
⁴Custom Craft Limited, Waterloo, ON

Contact Information:
 David Smyth e-mail: dsmyth@uwaterloo.ca; phone: 519-888-4567x2899; fax: 519-746-3882
 Dr. David Blowes e-mail: blowes@uwaterloo.ca; phone: 519-888-4878; fax: 519-746-3882



Presented at the Canadian Water Network Meeting, Ottawa, ON, June 2004

Introduction

Eutrophication of aquatic ecosystems as a consequence of excessive loading of phosphorus and other nutrients is a common local and watershed-scale problem. Phosphorus is typically present at concentrations between 0.005 and 0.05 mg/L in ground water and surface water. Elevated concentrations of phosphorus significantly above background levels can be generated through activities and facilities associated with agriculture, waste management and urbanization. To minimize impacts on groundwater and aquatic systems, phosphorus removal from groundwater, domestic wastewater and storm water can form part of nutrient management programs.

Permeable reactive mixtures containing Basic Oxygen Furnace (BOF) slag can remove phosphorus from water to very low concentrations. BOF slag is a non-metallic waste byproduct of steel production and is a poorly sorted mixture of material ranging in grain size from silt to fine gravel. Generated at several steel plants across North America, BOF slag contains significant concentrations of iron and calcium oxyhydroxides (Proctor et al., 2000). In contact with water, BOF slag promotes high pH (~10 to 12) conditions. BOF slag in permeable mixtures can be used to remove phosphorus and pathogens from groundwater in permeable reactive barriers (PRBs), and in chambers or large basins for treatment of storm water and effluent from domestic and communal wastewater systems.






Testing and Applications

Continuous testing to assess the long-term performance of phosphorus removal systems has been carried out for more than 10 years. Baker et al. (1998) initiated testing with laboratory columns containing BOF oxide and slag mixtures. Column influent concentrations of 3 mg/L PO₄-P were lowered to less than 0.05 mg/L for more than 10 years of continuous operation. Phosphorus removal was through adsorption and precipitation of a Ca-PO₄ solid. Baker et al. (1997) evaluated BOF slag in a PRB to treat phosphorus in groundwater emanating from a septic system. Excellent removal was observed. Phosphorus also was removed from a stream of effluent from a municipal wastewater treatment plant using BOF oxide. More recently, BOF slag in chambers has been used to treat septic-system effluent at a lakeside home near North Bay, communal wastewater effluent in Cape Cod, Massachusetts, and storm water associated with a new development north of Toronto, Ontario.








Cape Cod Demonstration

A concrete tank containing BOF slag was installed at the Massachusetts Alternative Septic System Test Center in October 2001. Aerobically treated communal wastewater with low biological oxygen demand (BOD) was introduced to the chamber over a period of two years. Flow of water is upward through the BOF slag mixture. Removal of total phosphorus and ortho-phosphate P to concentrations of approximately 0.05 mg/L or less was routinely achieved.



North Bay Demonstration

A project was implemented and administered by the provincial and municipal governments to remove phosphorus from septic system effluent. Since 1999, septic effluent from a single-family residence near North Bay, Ontario, has been treated in an aerobic sand filter, followed by a BOF slag chamber (Smyth et al., 2002). Phosphorus concentrations of approximately 5 mg/L PO₄-P in the septic system effluent were lowered to less than 0.02 mg/L PO₄-P in discharge from the BOF slag treatment chamber. The chamber also effectively removed E-coli from the wastewater. Neutralization of the pH occurred in groundwater adjacent to the subsurface discharge gallery. No maintenance of the influent and effluent lines of the BOF chamber was required for the first four years of operation. The lines were flushed hydraulically once to remove accumulated sludge.

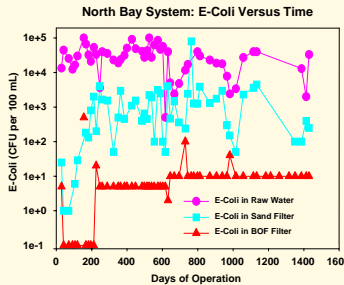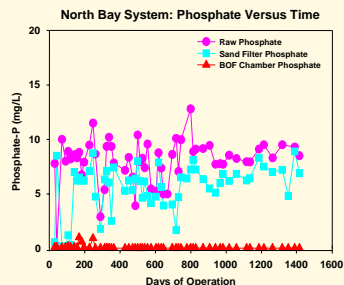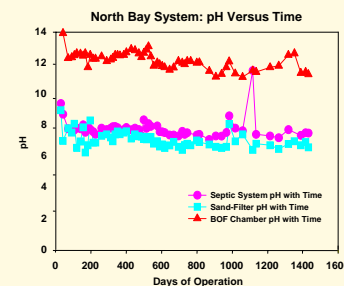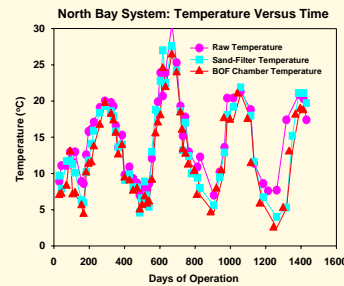

Summary

Reduction of phosphorus concentrations in water entering aquatic ecosystems is a key component of many nutrient management programs. BOF slag can be applied in passive permeable reaction systems to intercept and remove phosphorus to very low levels prior to discharge to aquatic ecosystems. The approach is low cost, and makes beneficial use of waste materials from the steel industry.

Acknowledgements

The researchers would like to acknowledge the following sources of funding and support:

- Canadian Water Network
- Natural Sciences and Engineering Research Council of Canada Discovery Funds
- Canada Research Chair (David Blowes)
- Custom Craft Ltd.
- Massachusetts Alternative Septic System Test Center, Barnstable County Health and Environmental Department, Barnstable County, MA

Special appreciation is expressed to the Bailey family for their participation in the North Bay demonstration project, and their permission for continued access to the property. Mike Moncur's assistance in preparing the poster is gratefully acknowledged.

References

Baker, M.J., Blowes, D.W. and Płacek, C.J., 1997. Phosphorus adsorption and precipitation in a permeable reactive wall: applications for wastewater disposal systems. *Land Contamination and Reclamation* 5(3): 189-194.
 Baker, M.J., Blowes, D.W. and Płacek, C.J., 1998. Laboratory development of reactive mixtures for the removal of phosphorus from onsite wastewater disposal systems. *Environmental Science and Technology*, 32(15): 2308-2316.
 Blowes, D.W., C.J. Płacek and M. Baker, 1996. Treatment of wastewater. G.B. Patent 2,306,954 issued Dec. 1, 1999; 1996; Canadian Patent 2,190,933, filed November 11, 1996; U.S. Patent 5,876,506, issued March 9, 1999. Phosphex™ Canadian trademark registration 1,051,185 filed March 17, 2000. Phosphex™ U.S. trademark registration 78015,068 filed June 30, 2000.
 Proctor, D.M., Fehling, K.A., Shay, E.C., Wittenborn, J.L., Green, J.J., Avent, C., Bigham, R.D., Connolly, M., Lee, B., Shepler, T.O., and Zak, M.A., 2000. Physical and chemical characteristics of blast furnace, basic oxygen furnace, and electric arc furnace steel industry slags. *Environmental Science and Technology*, 34(8): 1576-1582.
 Smyth, D.J.A., Blowes, D.W., Płacek, C.J., Baker, M.J., Ford, G., Foss, S., and Bernstene, E., 2002. Removal of phosphate and waterborne pathogens from wastewater effluent using permeable reactive materials. In *Ground and Water: Theory to Practice, Proceedings of the 55th Canadian Geotechnical and 3rd Joint IAHR-CNC and CGS Groundwater Specialty Conferences*, Niagara Falls, Ontario, October 20 to 23, pp. 1123-1128.